




1 2 2a 3

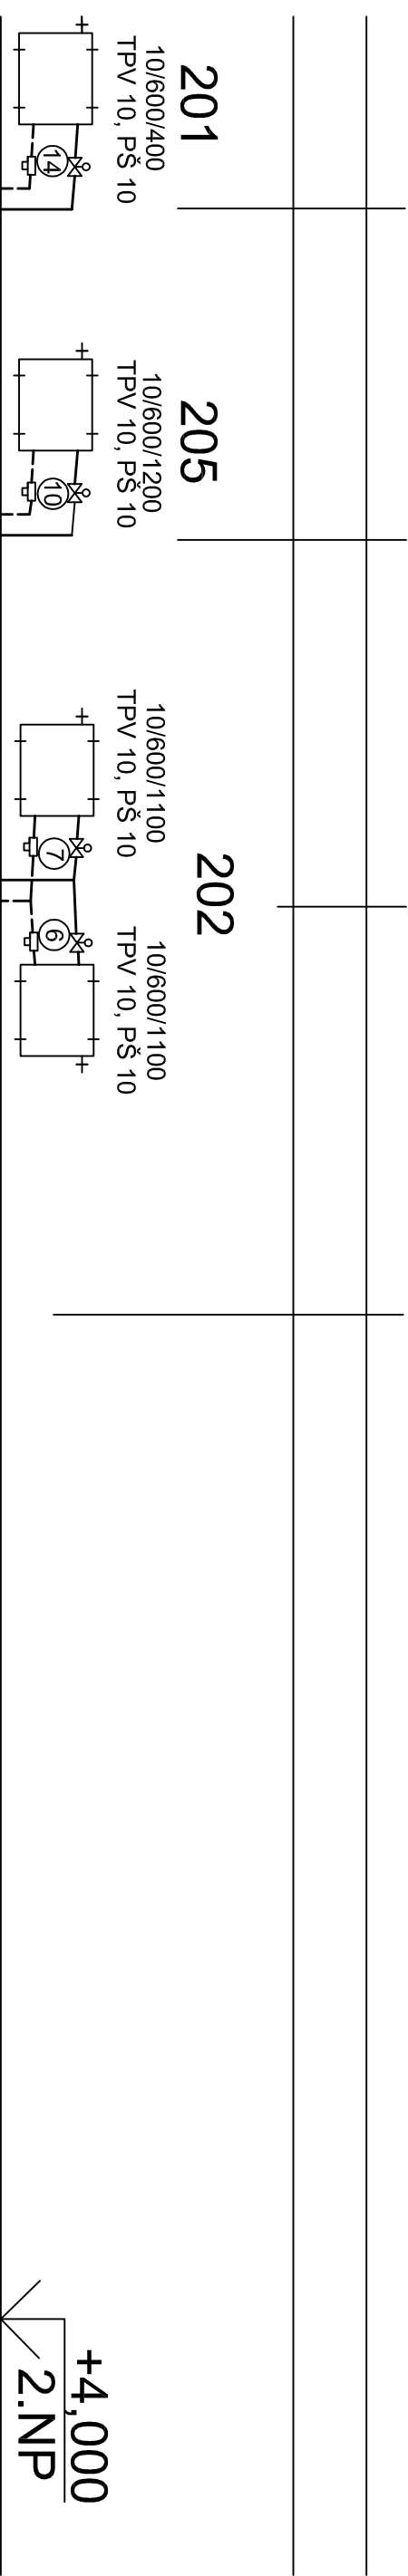

+4,000
2.NP

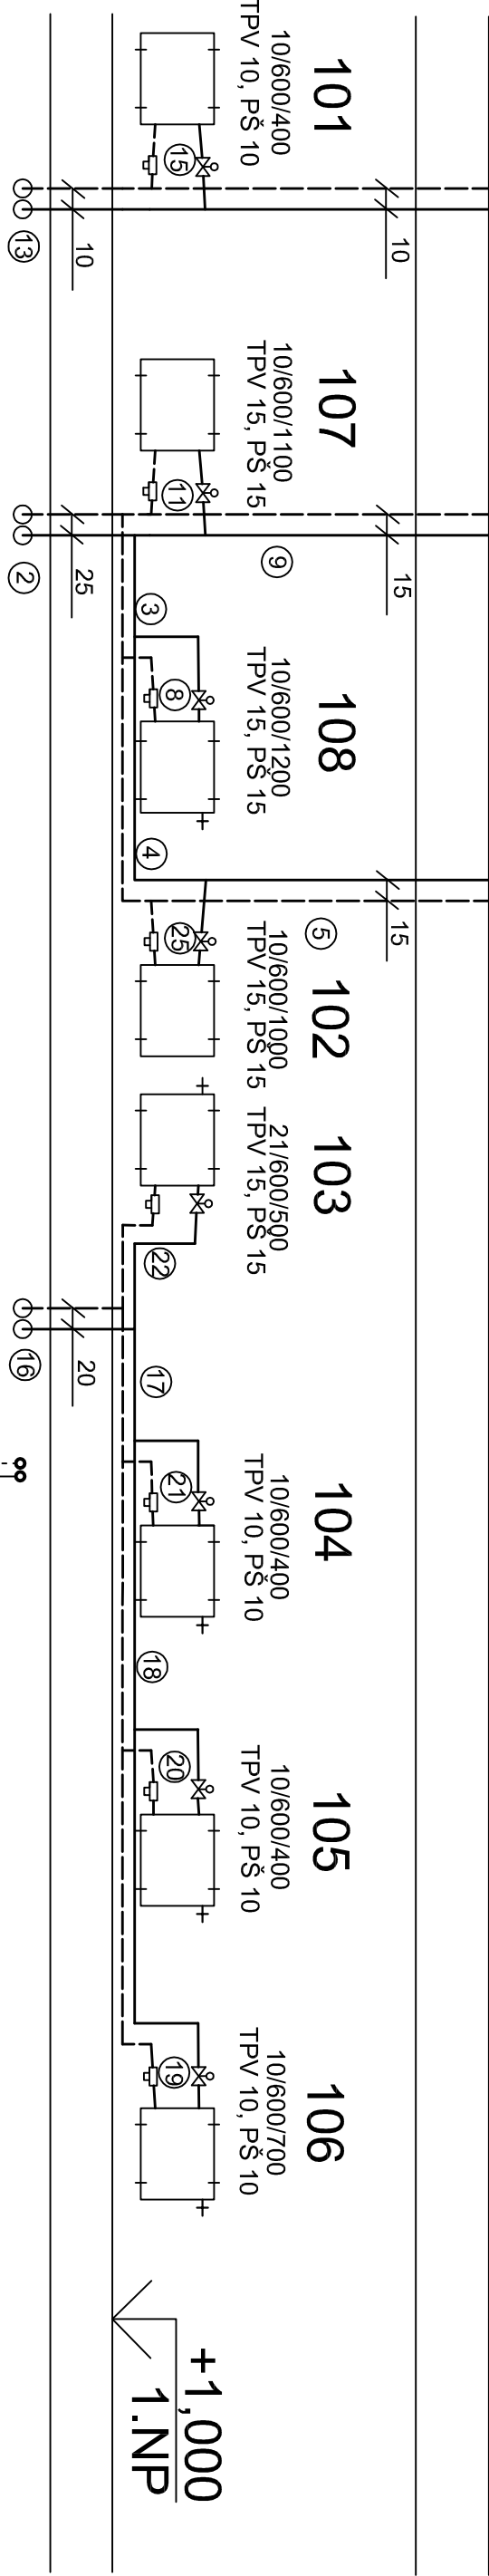

+1,000
1.NP

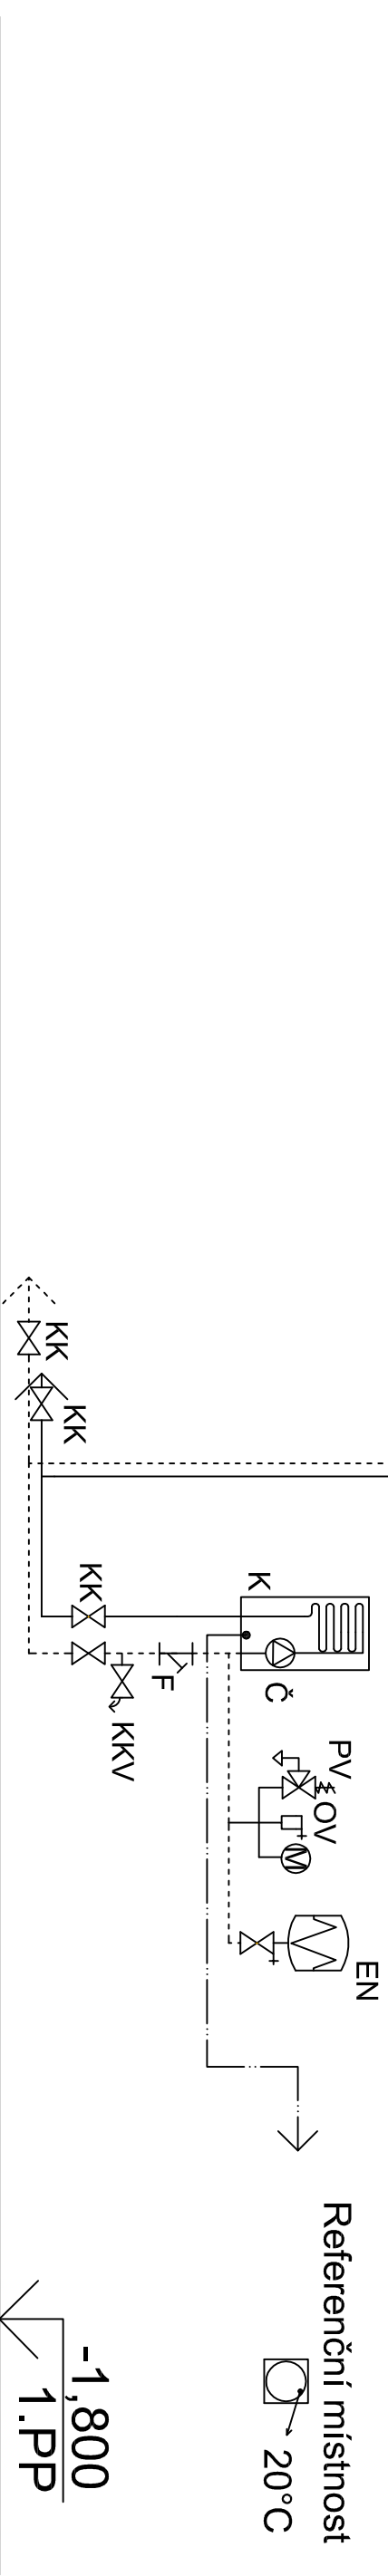

-1,800
1.PP

Referenční místnost
20°C